


Upper Condamine Water Supply Scheme

April 2017

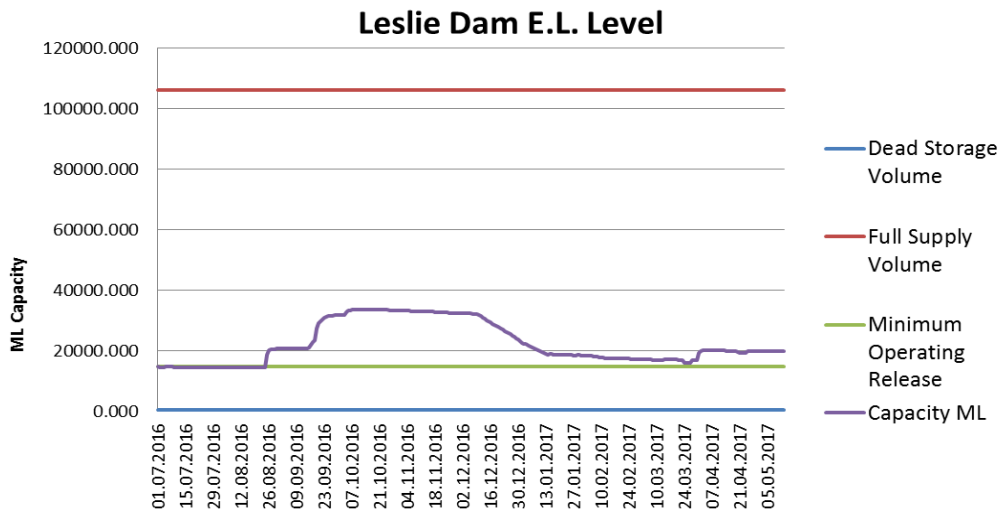

Current System Accounting

The current preliminary water usage for the Upper Condamine year to date 31 March 2017

Allocation water not yet delivered: 5,645ML

Allocation Water and Risk Allocation Water delivered: 18,620ML

Stream Flow: 7,051ML

Water Harvesting: 10,776ML

These figures are based on meter reads and may be subject to change.

The Upper Condamine (North Branch) will have a shutdown from 29 May for 14 days to allow the refurbishment of the rising main at Yarralong Pump Station.

Refurbishment Work 2017

Refurbishment Work to be completed this financial year:

- 3 pumps at Yarralong – 2 pumps were completed prior to last water harvesting event the remaining 1 pump scheduled to be completed in April/May dependant on forecast weather conditions at that time – Budget \$83,000 YTD \$77,794
- Yarralong PSTN - Refurbishment of the Rising Main Pipeline – scheduled to be completed in April/May dependant on current weather conditions – Budget \$103,740 YTD \$23,427
- Lemon Tree Weir Gauging Station - Relocate Gauging Station to be completed by June 2017 – Budget \$18,454
- Talgai Weir Gauging Station - Relocate Gauging Station – to be completed by June 2017 – Budget \$18,454
- Inspection (5 Yearly) Comprehensive - Melrose Weir, Nangwee Weir & Wando Weir & Yarralong Weir – scheduled to be inspected in early April – Budget \$24,356
- Refurbish Gate 1 -5 Hydraulic Rams Leslie Dam – Completed – YTD \$122,971

SunWater website:

<http://www.sunwater.com.au/>

Irrigator Advisory Committee:

<http://www.sunwater.com.au/schemes/upper-condamine/scheme-information/iac>

Storage Forecast Graphs

http://www.sunwater.com.au/_data/storageforecast/Forecast_Portal.htm#Leslie

Technical data

Leslie Dam

Full Supply Capacity

106,250 ML

Capacity @ 1 July 2016

14,737ML

Current Capacity @ 1 April 2017

20,106ML

Medium Priority Cut Off

460.35 m AHD

(14,990ML or 14.1% FSL)

Monthly Volume Change

2,864

Volume Released (as per TW Gauge)

YTD

10,274 ML

Yarralong Pump Station

Hours Pumped

1,115

ML Delivered to North Branch

4,350ML

Announced Allocation

Medium Priority @ 01.04.2017

75%