

SunWater Limited
Level 10, 179 Turbot Street
PO Box 15536 City East
Brisbane Queensland 4002
www.sunwater.com.au
ACN 131 034 985



Prepared for **Queensland Water Supply Regulator, Department of Energy
and Water Supply**

Public Report

Chinchilla Beneficial Use Scheme

Water Quality Report 01 January – 31 March 2014

Date: April 2014

Project: P-ASWP-0036-AA-01

File No: 13-005745/001

Table of Contents

1. Summary	1
2. Introduction.....	2
3. Kenya Water Treatment Facility Description.....	5
3.1 Aggregation & Feed Ponds	5
3.2 Ultrafiltration	5
3.3 Ion Exchange.....	6
3.4 Reverse Osmosis	6
3.5 Conditioning.....	6
4. Approvals	6
5. Water Quality Monitoring	6
5.1 External Water Quality Monitoring	6
5.2 Treated Water Testing Results	7
5.3 Non Compliances	9
6. Abbreviations & Acronyms.....	10

List of Figures

Figure 1: Chinchilla Reuse Scheme Overview.....	3
---	---

List of Tables

Table 1: 1 st Quarter 2014 Treated Water Monitoring Results Summary	7
--	---

List of Photographs

Photo 1: Kenya to Chinchilla Weir Pipeline Outfall.....	4
---	---

List of Appendices

APPENDIX A: Summary of Weekly and Quarterly Treated CSG Water Quality Monitoring	
--	--

1. Summary

The Chinchilla Beneficial Use Scheme involves the use of coal seam gas (CSG) water that has been treated at the Kenya Water Treatment Plant (WTP). The overall scheme and pipeline component are managed by SunWater, while the treatment plant operation is managed by QGC Pty Ltd.

SunWater is a bulk water infrastructure developer and manager playing a key role in Australia's water industry, owning and managing around \$7 billion in water infrastructure assets, and supplying approximately 40% of all water used commercially in Queensland.

QGC, a wholly owned subsidiary of the BG Group, is developing CSG fields in the Surat Basin. CSG is transported to a Liquefied Natural Gas (LNG) facility on Curtis Island, prior to export, while the CSG water is treated at WTPs for reuse.

The Chinchilla Beneficial Use Scheme involves the release of treated water into the Chinchilla Weir, mainly for use by irrigators. The release of treated water into Chinchilla Weir is regulated under the approved Interim Recycled Water Management Plan (RWMP), which commenced 18 July 2013. The conditions of the approved interim RWMP require the release of quarterly reports covering the water quality analysis. The interim RWMP is administered by the Queensland Water Supply Regulator (QWSR).

This report presents a summary of the available water quality monitoring results obtained during the 1st Quarter of 2014 for the Chinchilla Beneficial Use Scheme. It covers the period 01 January to 31 March 2014.

During the 1st Quarter of 2014, all confirmed results were within the limits stipulated in the RWMP. Two exceedences were reported to QWSR. Through the resulting incident investigations these exceedences were found to have occurred due to laboratory errors, with all confirmed results being within the stipulated limits.

This report has been produced in accordance with the 'Public Reporting Guideline for Recycled Water Schemes' (DEWS 2011) and the Water Supply (Safety and Reliability) Act 2008 (the Act).

2. Introduction

During the process of CSG extraction, groundwater is released as a by-product, known as CSG water. The quality and quantity of CSG water released through the gas extraction process varies over time and according to the unique geological attributes of a given area. The CSG water quality is generally low, with limited applications for its direct use. To ensure this resource can be beneficially used, the CSG water is treated to a standard suitable for irrigation, stock watering and augmentation of drinking water supplies. The WTP treats the CSG water to a high standard as per the interim RWMP, through a multi-stage robust treatment process, as detailed in Section 3.

The Kenya WTP and the Kenya to Chinchilla Pipeline produce and deliver treated CSG water to agricultural customers for beneficial use as part of the Chinchilla Beneficial Use Scheme. Beneficial use of the treated CSG water occurs along the Kenya to Chinchilla pipeline and within the existing Chinchilla Weir Water Supply Scheme by two groups of customers; agricultural use (irrigation and stock watering); and augmentation of the water supply for the Chinchilla township. The majority of the treated CSG water is used beneficially by irrigators for crop production. Refer to Figure 1 for an overview of the Scheme.

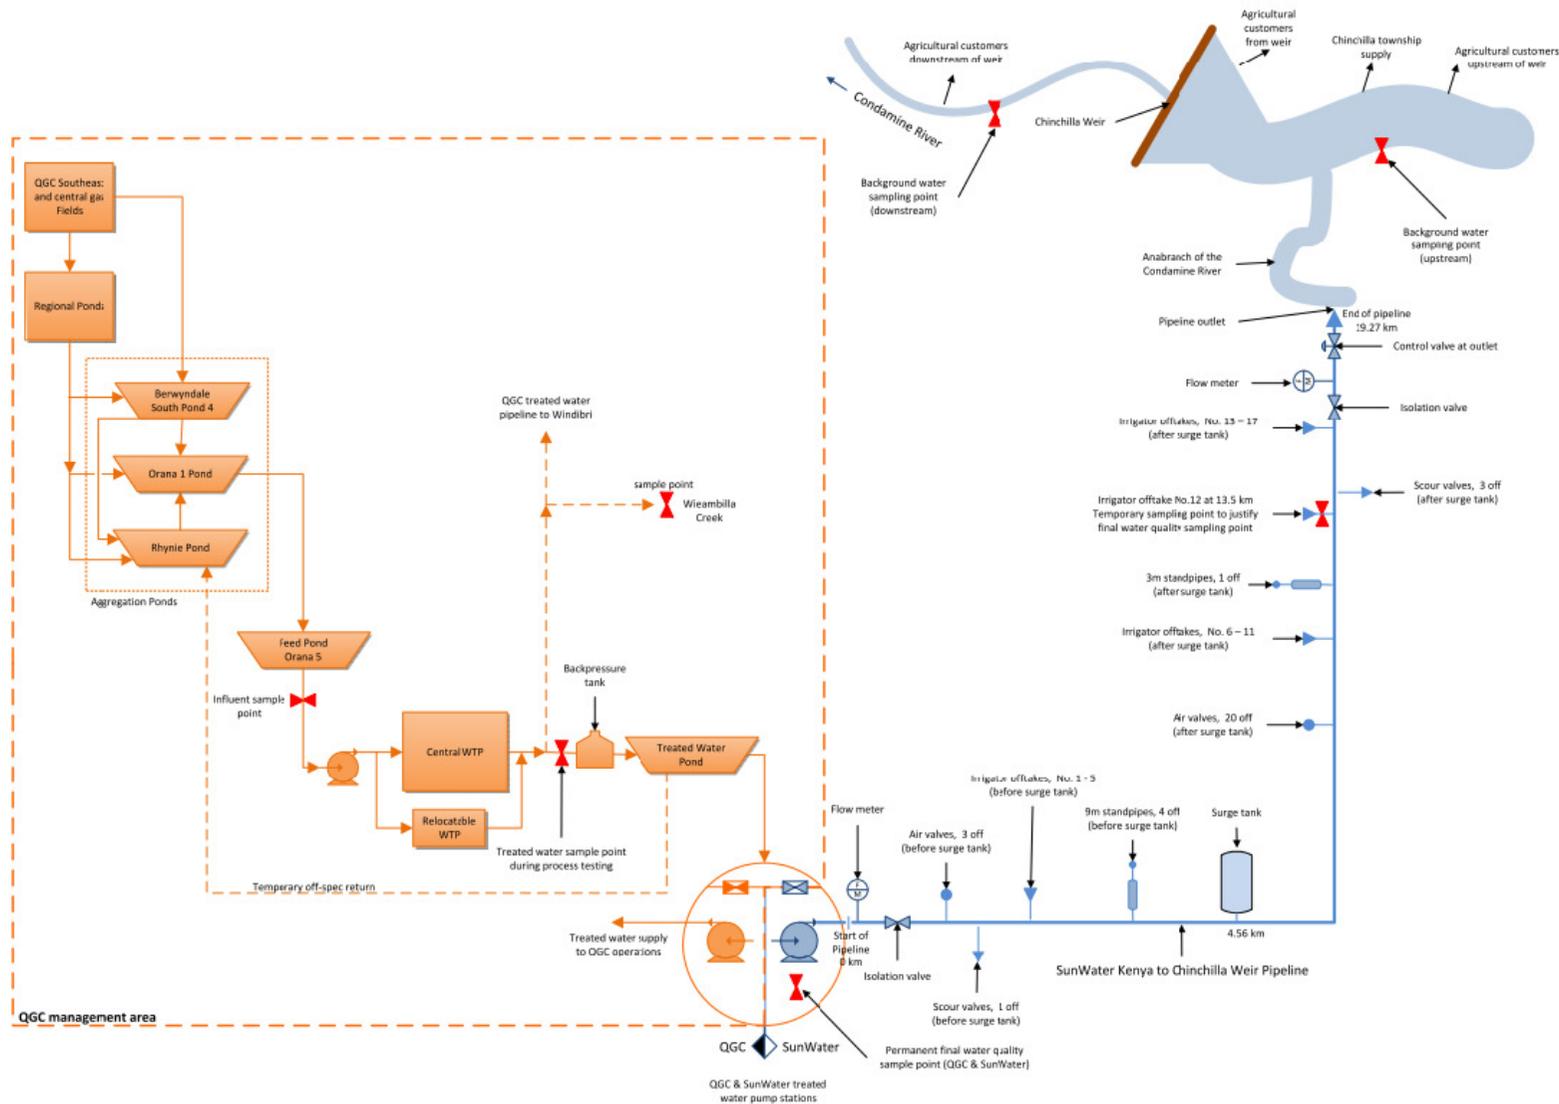


Figure 1: Chinchilla Reuse Scheme Overview

The water is distributed to customers in a manner that ensures it does not pass beyond the boundaries of the scheme, meaning that the Chinchilla beneficial Use Scheme is operated in a way that preserves and protects the existing cultural and economic values of the receiving environment. The majority of CSG water customers extract water from the Chinchilla Weir. Discharge to the Chinchilla Weir is via the approved discharge point under the RWMP, while monitoring occurs at both the WTP outlet (at the Treated Water Pump Station) and prior to discharge into the Chinchilla Weir.



Photo 1: Kenya to Chinchilla Weir Pipeline Outfall

To ensure the quality of the water provided to SunWater is consistently of a standard that protects public health and safety, water quality samples are taken weekly and sent to NATA accredited laboratory for independent analysis and reporting. The suite of analytes monitored in each sample are in accordance with the conditions of the RWMP, which groups analytes into weekly, quarterly and annual monitoring requirements.

This report summarises the results of the weekly and quarterly monitoring conducted during the period 01 January to 31 March 2014. SunWater is presenting this information in a format consistent with the Interim RWMP requirements to provide transparency in its operations and providing the community of the Western Downs with relevant information.

This report will be made available and can be viewed and downloaded from the SunWater website at www.sunwater.com.au. Any further queries relating to this report can be made by calling 13 15 89.

3. Kenya Water Treatment Facility Description

The Kenya WTP utilises a multiple barrier treatment process including Ultrafiltration (UF), Ion Exchange (IX) and Reverse Osmosis (RO). These steps ensure that the water can safely and reliably be produced to a quality suitable for discharge into the Chinchilla Weir. Key steps used in the treatment process include:

- Aggregation & Feed Ponds
- Ultrafiltration
- Ion Exchange
- Reverse Osmosis
- Conditioning

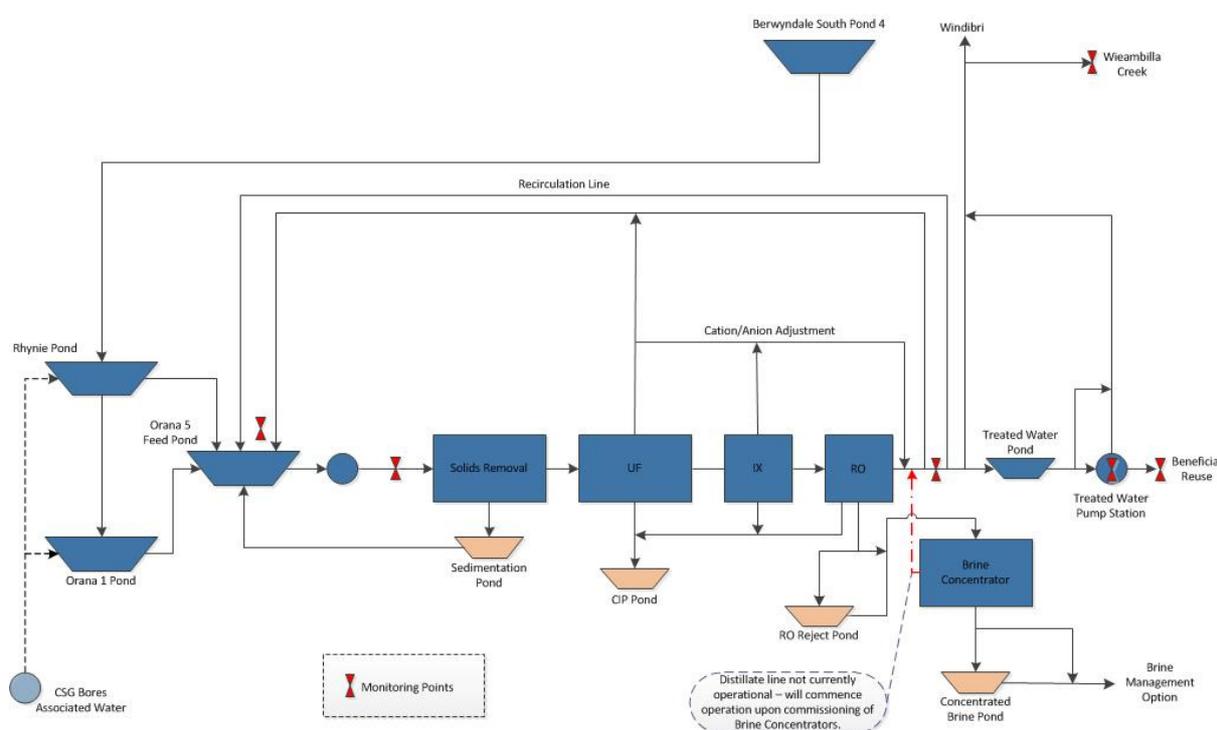


Figure 2: Kenya Water Treatment Plant

3.1 Aggregation & Feed Ponds

The water extracted during the CSG extraction process is stored in aggregation ponds before being delivered to the feed pond prior to the Kenya WTP. As all storage ponds are exposed to their surrounding environment, the water is susceptible to the natural effects of evaporation, sunlight, the atmosphere and rainwater, potentially altering its characteristics.

3.2 Ultrafiltration

Before being fed to the Ultrafiltration units, the water passes through disc filters to remove large solids and all other contaminants which could cause irreversible fouling to downstream water treatment processes, excessive frequency of cleaning, or premature degradation of the RO membranes. The water may also be dosed with additives to prevent bio fouling, scaling and aid in coagulation.

The Ultrafiltration units remove all particulate material, utilising a hollow fibre membrane with ultra-fine pores.

3.3 Ion Exchange

The Ion Exchange process removes divalent and trivalent metal ions, such as calcium and magnesium.

3.4 Reverse Osmosis

Water is passed at high pressure through fine membranes. This removes most of the dissolved salts and other trace elements.

3.5 Conditioning

Prior to entering the treated water pond the pH of the treated CSG water is adjusted to meet stipulated approval limits (6.5 to 8.5 pH units). At this stage calcium and magnesium are added to adjust the Sodium Absorption Ratio (SAR) within stipulated approval limits. This is done in accordance with the Beneficial Use Approval (environmental protection requirements) and to ensure the suitability with intended reuse objectives.

4. Approvals

In order to discharge into the Chinchilla Weir, SunWater have secured two separate approvals. A notice of approval of a resource for beneficial use (ENBU02701811) was granted on 1 August 2011. This approval is managed under the Queensland Governments Department of Environment and Heritage Protection (DEHP). The Beneficial Use Approval is in place to ensure that the water is appropriately reused and carefully managed to minimise any risk of environmental harm.

On 18 July 2013 SunWater, as Scheme Manager for the multiple-entity Chinchilla beneficial Use Scheme was issued an approval from the Department of Energy and Water Supply for its interim Recycled Water Management Plan. The RWMP is in place to ensure that there will be no adverse effects on a community's water supply.

During the first quarter 2014 reporting period two non-compliances under the RWMP were reported. Through the incident investigation process these were found to be laboratory errors, with all confirmed results being within the specified limits.

5. Water Quality Monitoring

5.1 External Water Quality Monitoring

Treated water is sampled on a weekly and quarterly basis in the treated water pump station for the parameters stated in Table 1 of SunWater's interim RWMP approval. Each quarter, one of the weekly sampling events will test for all parameters detailed in Table 1 of the CSG interim RWMP approval, constituting a quarterly monitoring round.

During the period of this report, sampling was undertaken on the following dates:

Weekly Sampling: 13/01/2014, 10/02/2014, 17/02/2014, 24/02/2014, 03/03/2014, 10/03/2014, 17/03/2014, and 24/03/2014.

Quarterly Sampling: 07/01/2014, 31/03/2014.

Annual Sampling: 20/01/2014, 28/01/2014, and 03/02/2014.

5.2 Treated Water Testing Results

The treated water testing results for the 1st Quarter of 2014 reporting period are summarised in Table 1. A more detailed listing of the monitoring results is contained in Appendix A. All confirmed results were compliant with the specified limits in the interim RWMP.

Table 1: 1st Quarter 2014 Treated Water Monitoring Results Summary

Parameter Group	Parameter	CAS Number	Compliance with Water Quality Limit	Water Quality Limit	Unit	Maximum	Count of Samples	Required Testing Frequency
Endocrine Disrupting Compounds	Nonylphenol	25154-52-3	100%	500	µg/L	<LOR	5	Quarterly
Disinfection By-Products	Bromochloroacetonitrile	83463-62-1	100%	0.7	µg/L	0.1	5	Quarterly
	Bromodichloromethane	75-27-4	100%	6	µg/L	<LOR	5	Quarterly
	Bromoform	75-25-2	100%	100	µg/L	2.3	5	Quarterly
	Chloroform(Trichloromethane)	67-66-3	100%	200	µg/L	<LOR	5	Quarterly
	Dibromochloromethane (DBCM)	124-48-1	100%	100	µg/L	<LOR	5	Quarterly
	Dichloroacetonitrile	3018-12-0	100%	2	µg/L	<LOR	5	Quarterly
Industrial Organics	Bisphenol A	80-05-7	100%	200	µg/L	<LOR	5	Quarterly
Inorganics	Bromide	24959-67-9	100%	7000	µg/L	460	13	Weekly
	Cyanide - Total	57-12-5	100%	80	µg/L	<LOR	13	Weekly
	Fluoride	16984-48-8	100%	1500	µg/L	200	13	Weekly
	Iodide	20461-54-5	100%	100	µg/L	20	13	Weekly
	Sulfate	14808-79-8	100%	500000	µg/L	<LOR	13	Weekly
Metals	Aluminium - Total	7429-90-5	100%	200	µg/L	16	13	Weekly
	Antimony - Total	7440-36-0	100%	3	µg/L	<LOR	5	Quarterly
	Arsenic - Total	7440-38-2	100%	7	µg/L	<LOR	13	Weekly
	Barium - Total	7440-39-3	100%	700	µg/L	1	13	Weekly
	Boron - Total	7440-42-8	100%	4000	µg/L	630	13	Weekly
	Cadmium - Total	7440-43-9	100%	2	µg/L	<0.5	13	Weekly
	Chromium - Total	7440-47-3	100%	50	µg/L	1	13	Weekly
	Copper - Total	7440-50-8	100%	2000	µg/L	14	13	Weekly
	Iron - Total	7439-89-6	100%	300	µg/L	130	13	Weekly
	Lead - Total	7439-92-1	100%	10	µg/L	<LOR	13	Weekly

Parameter Group	Parameter	CAS Number	Compliance with Water Quality Limit	Water Quality Limit	Unit	Maximum	Count of Samples	Required Testing Frequency
	Manganese - Total	7439-96-5	100%	500	µg/L	2	13	Weekly
	Mercury - Total	7439-97-6	100%	1	µg/L	<LOR	13	Weekly
	Molybdenum - Total	7439-98-7	100%	50	µg/L	<LOR	13	Weekly
	Nickel - Total	7440-02-0	100%	20	µg/L	<LOR	13	Weekly
	Selenium - Total	7440-49-2	100%	10	µg/L	<LOR	5	Quarterly
	Silver - Total	7440-22-4	100%	100	µg/L	7	5	Quarterly
	Strontium - Total	7440-22-4	100%	4000	µg/L	12	13	Weekly
	Vanadium - Total	7440-62-2	100%	50	µg/L	2	5	Quarterly
	Zinc - Total	7440-66-6	100%	3000	µg/L	110	13	Weekly
Nitrosamines	NDMA (n-Nitrosodimethylamine)	62-75-9	100%	0.1	µg/L	<LOR	13	Weekly
Nutrients	Ammonia (as N) - Total	7664-41-7	100%	500	µg/L	90	13	Weekly
Polycyclic Aromatic Hydrocarbons	Benz[a]anthracene	56-55-3	Limits apply to sum total of Concentration X TEF.		µg/L	<LOR	13	Weekly
	Benzo[a]pyrene	50-32-8			µg/L	<LOR	13	Weekly
	Benzo[b+j]fluoranthene	205-99-2 + 205-82-3			µg/L	<LOR	13	Weekly
	Benzo[k]fluoranthene	207-08-9			µg/L	<LOR	13	Weekly
	Chrysene (Benzo[a]phenanthrene)	218-01-9			µg/L	<LOR	13	Weekly
	Dibenzo[a,h]anthracene	53-70-3			µg/L	<LOR	13	Weekly
	Indeno[1,2,3-cd]pyrene	193-39-5			µg/L	<LOR	13	Weekly
	PAH (as B(a)P TEF)				100%	0.01	µg/L	<LOR
Radionuclides	Lead-210	14255-04-0	Limits apply to sum total.		Bq/L	<0.2	4	Quarterly
	Polonium-210	13981-52-7			Bq/L	0.009	4	Quarterly
	Radium-226	7440-14-4			Bq/L	<LOR	4	Quarterly
	Radium-228	15262-20-1			Bq/L	<0.2	4	Quarterly
	Total est Radiological Dose (Gamma)		100%	0.5	mSv/yr	<LOR	4	Quarterly
Total Petroleum Hydrocarbons	C6-C9 Hydrocarbons		Limits apply to sum total.		µg/L	<LOR	13	Weekly

Parameter Group	Parameter	CAS Number	Compliance with Water Quality Limit	Water Quality Limit	Unit	Maximum	Count of Samples	Required Testing Frequency
	C10-C14 Hydrocarbons				µg/L	<LOR	13	Weekly
	C15-C28 Hydrocarbons				µg/L	<LOR	13	Weekly
	C29-C36 Hydrocarbons				µg/L	<LOR	13	Weekly
	Total Petroleum Hydrocarbons		100%	200	µg/L	<LOR	13	Weekly
Volatile Organic Compounds	Benzene	71-43-2	100%	1	µg/L	<LOR	13	Weekly
	Ethylbenzene	100-41-4	100%	300	µg/L	<LOR	13	Weekly
	Meta & Para Xylenes	108-38-3/106-42-3	100%	600	µg/L	<LOR	13	Weekly
	Ortho-Xylene	95-47-6	100%	600	µg/L	<LOR	13	Weekly
	Toluene	108-88-3	100%	800	µg/L	<LOR	13	Weekly
	Total Xylene	1330-20-7	100%	600	µg/L	<LOR	13	Weekly

5.3 Non Compliances

Two non-compliances were reported between 01 January 2014 and 31 March 2014.

An exceedence of the stipulated Iron concentration of 300µg/L was reported to the regulator on 10 February 2014. The initial result reported by the laboratory was 330µg/L from the weekly sample collected 20 January 2014. The resulting incident investigation revealed a transposing error at the laboratory, with the correct result being 130µg/L and within the stipulated limit.

An incorrect Limit of Reporting (LOR) for n-Nitrosodimethylamine (NDMA) of <5µg/L was identified by QWSR on 19 February 2014, and was formally reported to the regulator by SunWater on 03 March 2014. The initial result reported by the laboratory was <5µg/L from the weekly sample collected 20 January 2014. The resulting incident investigation revealed a reporting error at the laboratory, with the correct result being <0.1µg/L within the stipulated limit.

Actions taken to prevent the reoccurrence of such events in the future involved the laboratory establishing additional procedures to ensure more rigorous quality assurance and control of all water quality results. This includes introducing a dedicated consultant to review all reported results.

6. Abbreviations & Acronyms

Term/Abbreviation/Acronym	Definition
µg	Micrograms (1 x 10 ⁻⁶ grams)
BG	British Gas
Bq	Becquerel(s)
CAS	Chemical abstracts service
CSG	Coal seam gas
DERM	Department of Environment and Resource Management
DEHP	Department of Environment and Heritage Protection
DEWS	Department of Environment and Water Supply
IX	Ion exchange
L	Litre(s)
LNG	Liquefied natural gas
LOR	Practical limit of reporting.
mSv	Millisievert (measure of radiation dose)
NATA	National Association of Testing Authorities
ND	Not detected
pH	Power of hydrogen
QGC	Queensland Gas Company
QWSR	Queensland Water Supply Regulator
RO	Reverse Osmosis
RWMP	Recycled Water Management Plan
SAR	Sodium absorption ratio
TEF	Toxicity equivalence factor
the Act	Water Supply (Safety and Reliability) Act 2008
TPH	Total petroleum hydrocarbon(s)
TWPS	Treated water pump station
UF	Ultra filtration
WTP	Water treatment plant

APPENDIX A:
Summary of Weekly and Quarterly Treated CSG Water
Quality Monitoring
1st Quarter 2014

Parameter Group	Parameter	CAS Number	Compliance with Water Quality Limit	Water Quality Limit	Limit of Reporting (LOR)	Unit	Minimum	Mean	Maximum	Count of Samples	Count of positives	Required Testing Frequency
Endocrine Disrupting Compounds	Nonylphenol	25154-52-3	100%	500	100	µg/L	<LOR	0	<LOR	5	0	Quarterly
Disinfection By-Products	Bromochloroacetonitrile	83463-62-1	100%	0.7	0.1	µg/L	<LOR	0.02	0.1	5	1	Quarterly
	Bromodichloromethane	75-27-4	100%	6	0.5	µg/L	<LOR	0	<LOR	5	0	Quarterly
	Bromoform	75-25-2	100%	100	0.5	µg/L	<LOR	1.02	2.3	5	3	Quarterly
	Chloroform(Trichloromethane)	67-66-3	100%	200	0.5	µg/L	<LOR	0	<LOR	5	0	Quarterly
	Dibromochloromethane (DBCM)	124-48-1	100%	100	0.5	µg/L	<LOR	0	<LOR	5	0	Quarterly
	Dichloroacetonitrile	3018-12-0	100%	2	0.1	µg/L	<LOR	0	<LOR	5	0	Quarterly
Industrial Organics	Bisphenol A	80-05-7	100%	200	20	µg/L	<LOR	0	<LOR	5	0	Quarterly
Inorganics	Bromide	24959-67-9	100%	7000	20	µg/L	130	271	460	13	13	Weekly
	Cyanide - Total	57-12-5	100%	80	5	µg/L	<LOR	0	<LOR	13	0	Weekly
	Fluoride	16984-48-8	100%	1500	100	µg/L	<LOR	46	200	13	5	Weekly
	Iodide	20461-54-5	100%	100	20	µg/L	<LOR	4.6	20	13	3	Weekly
	Sulfate	14808-79-8	100%	500000	1000	µg/L	<LOR	0	<LOR	13	0	Weekly
Metals	Aluminium - Total	7429-90-5	100%	200	5	µg/L	<LOR	4.3	16	13	7	Weekly
	Antimony - Total	7440-36-0	100%	3	0.1	µg/L	<LOR	0	<LOR	5	0	Quarterly

Parameter Group	Parameter	CAS Number	Compliance with Water Quality Limit	Water Quality Limit	Limit of Reporting (LOR)	Unit	Minimum	Mean	Maximum	Count of Samples	Count of positives	Required Testing Frequency
	Arsenic - Total	7440-38-2	100%	7	1	µg/L	<LOR	0	<LOR	13	0	Weekly
	Barium - Total	7440-39-3	100%	700	1	µg/L	<LOR	0.3	1	13	4	Weekly
	Boron - Total	7440-42-8	100%	4000	10	µg/L	320	449	630	13	13	Weekly
	Cadmium - Total	7440-43-9	100%	2	0.1	µg/L	<LOR	0	<0.5	13	2	Weekly
	Chromium - Total	7440-47-3	100%	50	1	µg/L	<LOR	0.07	1	13	1	Weekly
	Copper - Total	7440-50-8	100%	2000	1	µg/L	<LOR	1.5	14	13	3	Weekly
	Iron - Total	7439-89-6	100%	300	50	µg/L	<LOR	22.6	130	13	5	Weekly
	Lead - Total	7439-92-1	100%	10	1	µg/L	<LOR	0.4	<LOR	13	2	Weekly
	Manganese - Total	7439-96-5	100%	500	1	µg/L	<LOR	0.76	2	13	7	Weekly
	Mercury - Total	7439-97-6	100%	1	0.5	µg/L	<LOR	0	<LOR	13	0	Weekly
	Molybdenum - Total	7439-98-7	100%	50	1	µg/L	<LOR	0	<LOR	13	0	Weekly
	Nickel - Total	7440-02-0	100%	20	1	µg/L	<LOR	0.23	<LOR	13	1	Weekly
	Selenium - Total	7440-49-2	100%	10	5	µg/L	<LOR	0	<LOR	5	0	Quarterly
	Silver - Total	7440-22-4	100%	100	1	µg/L	<LOR	1.4	7	5	1	Quarterly
	Strontium - Total	7440-22-4	100%	4000	1	µg/L	6	8.38	12	13	13	Weekly
	Vanadium - Total	7440-62-2	100%	50	1	µg/L	<LOR	0.4	2	5	1	Quarterly
	Zinc - Total	7440-66-6	100%	3000	5	µg/L	<LOR	17.4	110	13	8	Weekly

Parameter Group	Parameter	CAS Number	Compliance with Water Quality Limit	Water Quality Limit	Limit of Reporting (LOR)	Unit	Minimum	Mean	Maximum	Count of Samples	Count of positives	Required Testing Frequency
Nitrosamines	NDMA (n-Nitrosodimethylamine)	62-75-9	100%	0.1	0.1	µg/L	<LOR	0	<LOR	13	0	Weekly
Nutrients	Ammonia (as N) - Total	7664-41-7	100%	500	50	µg/L	<LOR	17.7	90	13	3	Weekly
Polycyclic Aromatic Hydrocarbons	Benz[a]anthracene	56-55-3	Limits apply to sum total of Concentration X TEF.		0.01	µg/L	<LOR	0	<LOR	13	0	Weekly
	Benzo[a]pyrene	50-32-8			0.01	µg/L	<LOR	0	<LOR	13	0	Weekly
	Benzo[b+j]fluoranthene	205-99-2 + 205-82-3			0.01	µg/L	<LOR	0	<LOR	13	0	Weekly
	Benzo[k]fluoranthene	207-08-9			0.01	µg/L	<LOR	0	<LOR	13	0	Weekly
	Chrysene (Benzo[a]phenanthrene)	218-01-9			0.01	µg/L	<LOR	0	<LOR	13	0	Weekly
	Dibenzo[a,h]anthracene	53-70-3			0.01	µg/L	<LOR	0	<LOR	13	0	Weekly
	Indeno[1,2,3-cd]pyrene	193-39-5			0.01	µg/L	<LOR	0	<LOR	13	0	Weekly
	PAH (as B(a)P TEF)		100%	0.01	0.01	µg/L	<LOR	0	<LOR	13	0	Weekly
Radionuclides	Lead-210	14255-04-0	Limits apply to sum total.		0.1	Bq/L	<LOR	0.1	<0.2	4	2	Quarterly
	Polonium-210	13981-52-7			0.002	Bq/L	<LOR	0.00225	0.009	4	1	Quarterly
	Radium-226	7440-14-4			0.1	Bq/L	<LOR	0	<LOR	4	0	Quarterly
	Radium-228	15262-20-1			0.1	Bq/L	<LOR	0.05	<0.2	4	1	Quarterly

Parameter Group	Parameter	CAS Number	Compliance with Water Quality Limit	Water Quality Limit	Limit of Reporting (LOR)	Unit	Minimum	Mean	Maximum	Count of Samples	Count of positives	Required Testing Frequency
	Total est Radiological Dose (Gamma)		100%	0.5	0.25	mSv/yr	<LOR	0	<LOR	4	0	Quarterly
Total Petroleum Hydrocarbons	C6-C9 Hydrocarbons		Limits apply to sum total.		20	µg/L	<LOR	0	<LOR	13	0	Weekly
	C10-C14 Hydrocarbons				50	µg/L	<LOR	0	<LOR	13	0	Weekly
	C15-C28 Hydrocarbons				100	µg/L	<LOR	0	<LOR	13	0	Weekly
	C29-C36 Hydrocarbons				50	µg/L	<LOR	0	<LOR	13	0	Weekly
	Total Petroleum Hydrocarbons		100%	200	200	µg/L	<LOR	0	<LOR	13	0	Weekly
Volatile Organic Compounds	Benzene	71-43-2	100%	1	0.5	µg/L	<LOR	0	<LOR	13	0	Weekly
	Ethylbenzene	100-41-4	100%	300	0.5	µg/L	<LOR	0	<LOR	13	0	Weekly
	Meta & Para Xylenes	108-38-3/106-42-3	100%	600	1	µg/L	<LOR	0	<LOR	13	0	Weekly
	Ortho-Xylene	95-47-6	100%	600	0.5	µg/L	<LOR	0	<LOR	13	0	Weekly
	Toluene	108-88-3	100%	800	0.5	µg/L	<LOR	0	<LOR	13	0	Weekly
	Total Xylene	1330-20-7	100%	600	1.5	µg/L	<LOR	0	<LOR	13	0	Weekly
<p>Note *1: The mean has been calculated by interpreting results of less than the Limit of Reporting (<LOR) as zero in line with section 2.5.2 of the Public Reporting Guideline for Recycled Water Schemes.</p> <p>Note *2: 'Count of positives' indicates results recorded above the detection limit.</p>												